




CITY OF LODI

PUBLIC WORKS DEPARTMENT

1" Water Service

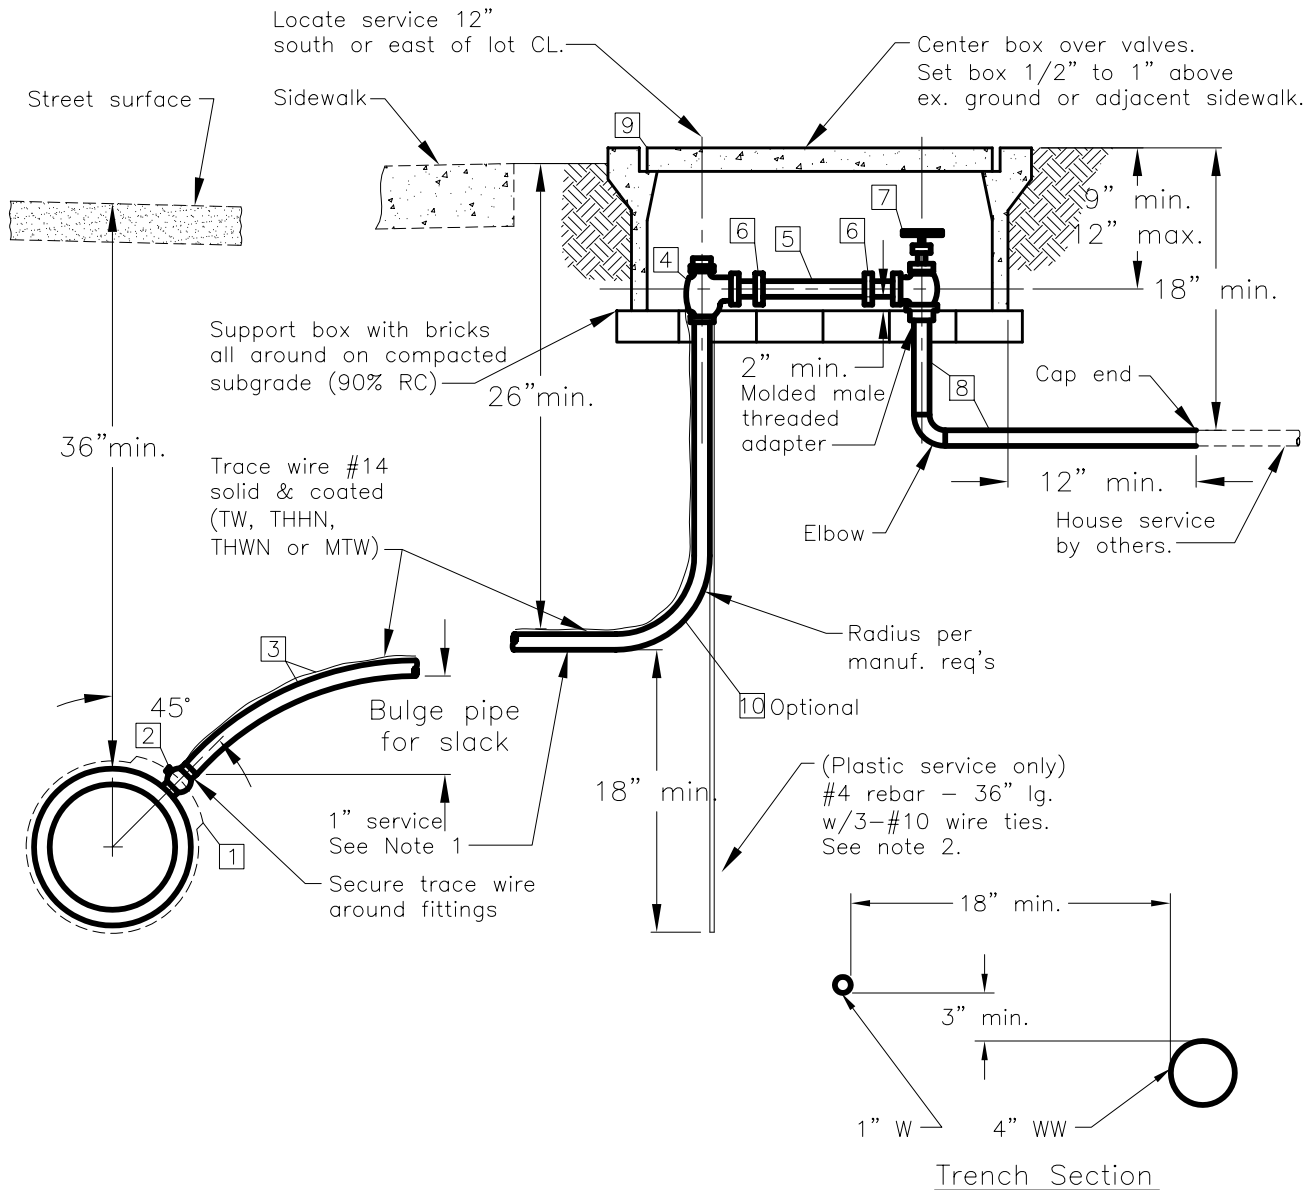

Notes:

1. Maintain 24" clearance between tap and any coupling, fitting or adjacent tap. Plastic services shall be looped approximately 6" vertically or laterally to provide slack in the line. If the service is installed in the same trench as the sanitary service, the water service shall be installed without splices and the trench section shown applies.
2. Backfill shall conform to Std. Plan 501.

Sheet 1 of 4

Dr. KT	No. 1	Date 9/25	Revision ADDED SECOND ITEM #6 & MADE ITEM #10 OPTIONAL	Appr.	Approved By: <i>F. Wally Sandelin</i>	9/25/02	STD PLAN
Ch. WS					F. Wally Sandelin City Engineer R.C.E. 39895	Date	403
Date 12/00							